



National Fenestration Rating Council Incorporated

NFRC 701.05-2012_[E0A0]

NFRC 201 Solar Calorimeter Test Reporting Requirements

© 2012 NATIONAL FENESTRATION RATING COUNCIL, INC.

PREPARED BY:

National Fenestration Rating Council
6305 Ivy Lane, Suite 140
Greenbelt, MD 20770
Voice: (301) 589-1776
Fax: (301) 589-3884
Email: info@nfr.org
Website: www.nfr.org



FOREWORD

The National Fenestration Rating Council, Incorporated ("NFRC") has developed and operates a uniform rating system for energy and energy-related performance of fenestration products. The Rating System determines the U-factor, Solar Heat Gain Coefficient (SHGC), and Visible Transmittance (VT) of a product, which are mandatory ratings for labeling NFRC certified products and are mandatory ratings for inclusion on label certificates, and are supplemented by procedures for voluntary ratings of products for Air Leakage (AL), and Condensation Resistance. Together, these rating procedures, as set forth in documents published by NFRC, are known as the NFRC Rating System.

The Rating System employs computer simulation and physical testing by NFRC-accredited laboratories to establish energy and related performance ratings for fenestration product types. The Rating System is reinforced by a certification program under which NFRC-licensed responsible parties claiming NFRC product certification shall label and certify fenestration products to indicate those energy and related performance ratings, provided the ratings are authorized for certification by an NFRC-licensed certification and Inspection Agency (IA).

The requirements of the rating, certification, and labeling program (the "Certification Program") are set forth in the most recent versions of the following as amended, updated or interpreted from time to time:

- NFRC 700 Product Certification Program (the "PCP")
- NFRC 705 Component Modeling Approach ("CMA") Product Certification Program (the "CMA-PCP").

Through the Certification Programs and the most recent versions of its companion programs as amended, updated or interpreted from time to time:

- The laboratory accreditation program (the "Accreditation Program"), set forth in the NFRC 701 Laboratory Accreditation Program (the "LAP")
- The IA licensing program (the "IA Program"), set forth in NFRC 702 Certification Agency Program (the "CAP")
- The CMA Approved Calculation Entity ("ACE") licensing program (the "ACE Program") as set forth in the NFRC 708 Calculation Entity Approval Program (the "CEAP"),

NFRC intends to ensure the integrity and uniformity of NFRC ratings, certification, and labeling by ensuring that responsible parties, testing and simulation laboratories, and IAs adhere to strict NFRC requirements.

In order to participate in the Certification Programs, a manufacturer / responsible party shall rate a product whose energy and energy-related performance characteristics are to be certified in accordance with mandatory NFRC rating procedures. At present, a manufacturer/responsible party may elect to rate products for U-factor, SHGC, VT, Air Leakage, Condensation Resistance, or any other procedure adopted by NFRC, and to include those ratings on the NFRC temporary label affixed to its products, or on the NFRC Label Certificate. U-factor, SHGC and VT, AL, and Condensation Resistance rating reports shall be obtained from a laboratory, which has been accredited by NFRC in accordance with the requirements of the NFRC 701.

The rating shall then be reviewed by an IA which has been licensed by NFRC in accordance with the requirements of the NFRC 702. NFRC-licensed IAs also review label format and content, conduct in-plant inspections for quality assurance in accordance with the requirements of the NFRC 702, and issue a product Certification Authorization Report (CAR), or approve for issuance an NFRC Label Certificate for site-built or CMA products and attachment products. The IA is also responsible for the investigation of potential violations (prohibited activities) as set forth in the NFRC 707 Compliance and Monitoring Program.

Ratings for products that are labeled with the NFRC Temporary and Permanent Label, or products that are listed on an NFRC Label Certificate, in accordance with NFRC requirements, are considered to be NFRC-certified. NFRC maintains a Certified Products Directory (CPD), listing product lines and individual products selected by the manufacturer/responsible party for which certification authorization has been granted.

NFRC manages the Rating System and regulates the Product Certification Program (PCP), Laboratory Accreditation Program (LAP) and Certification Agency Program (CAP) in accordance with the NFRC 700 (PCP), the NFRC 701 (LAP), the NFRC 702 (CAP), the NFRC 705 (CMA-PCP), and the NFRC 708 (CEAP) procedures, and conducts compliance activities under all these programs as well as the NFRC 707 Compliance and Monitoring Program (CAMP). NFRC continues to develop the Rating System and each of the programs.

NFRC owns all rights in and to each of the NFRC 700, NFRC 701, NFRC 702, NFRC 705, NFRC 707, NFRC 708 and each procedure, which is a component of the Rating System, as well as each of its registration marks, trade names, and other intellectual property.

The structure of the NFRC program and relationships among participants are shown in Figure 1, Figure 2, and Figure 3. For additional information on the roles of the IAs and laboratories and operation of the IA Program and Accreditation Program, see the NFRC 700 (PCP), NFRC 701 (LAP), and NFRC 702 (CAP) respectively.

Figure 1

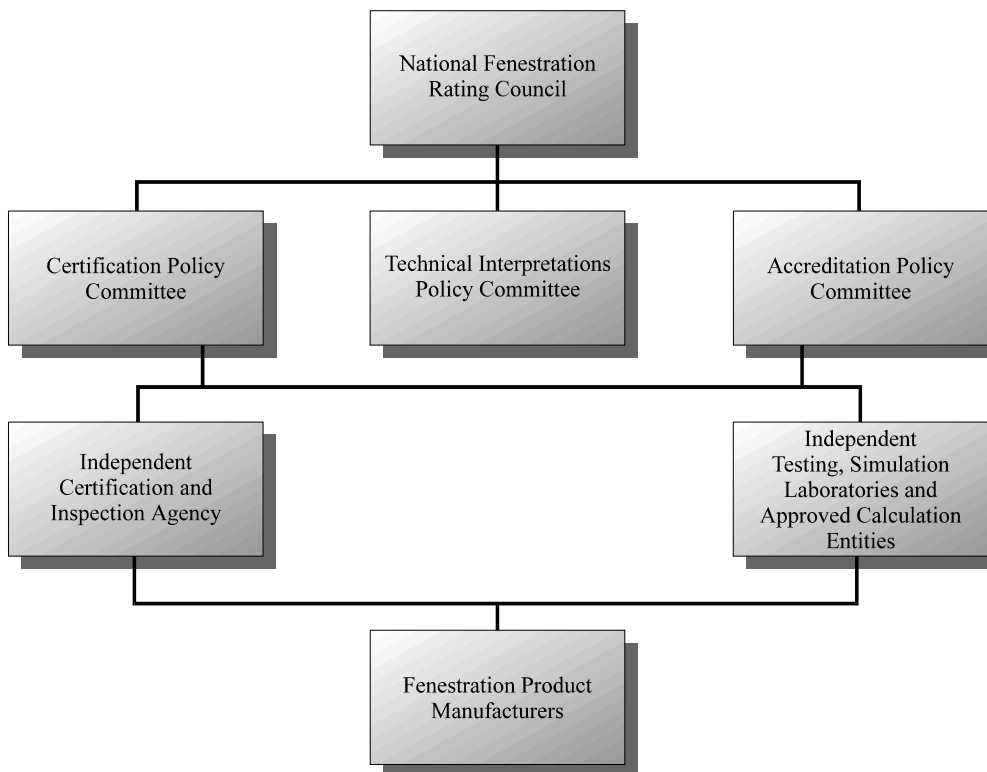


Figure 2


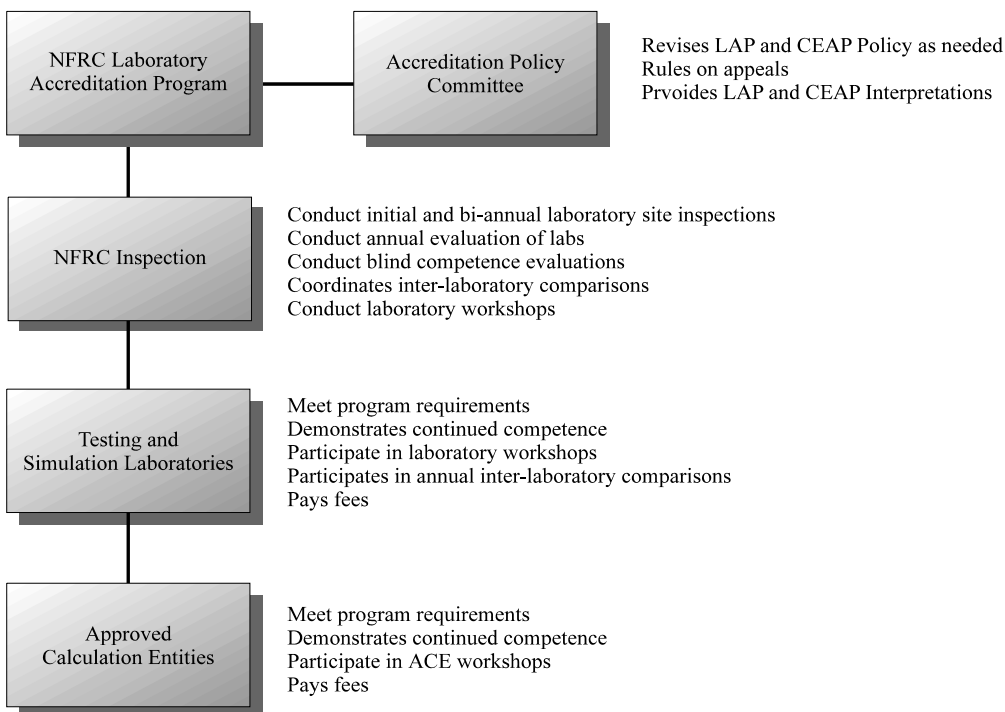


Figure 3



Questions on the use of this procedure should be addressed to:

National Fenestration Rating Council
6305 Ivy Lane, Suite 140
Greenbelt, MD 20770
Voice: (301) 589-1776
Fax: (301) 589-3884
Email: info@nfrc.org
Website: www.nfrc.org

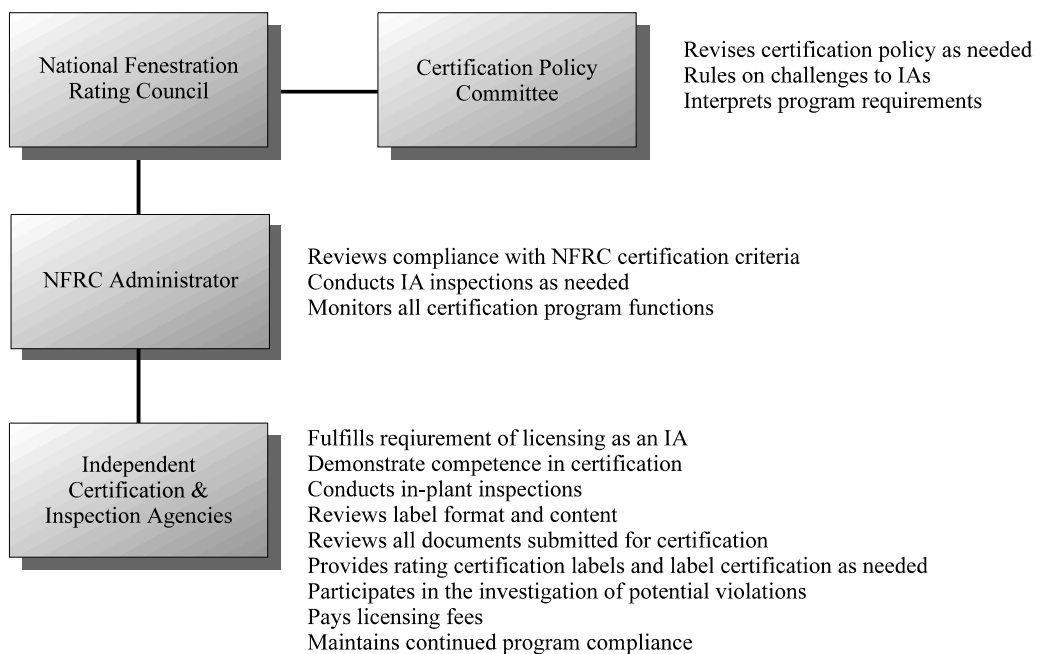

DISCLAIMER

NFRC certification is the authorized act of a manufacturer/responsible party in: (a) labeling a fenestration or related attachment product with an NFRC Permanent Label and NFRC Temporary Label, or (b) generating a site built or CMA label certificate, either of which bears one or more energy performance ratings reported by NFRC-accredited simulation and testing laboratories and authorized for certification by an NFRC-licensed IA. Each of these participants acts independently to report, authorize certification, and certify the energy-related ratings of fenestration and related attachment products.

NFRC does not certify a product and certification does not constitute a warranty of NFRC regarding any characteristic of a fenestration or fenestration-related attachment product. Certification is not an endorsement of or recommendation for any product or product line or any attribute of a product or product line. NFRC is not a merchant in the business of selling fenestration products or fenestration-related products, and therefore cannot warrant products as to their merchantability or fitness for a particular use.

NFRC THEREFORE DISCLAIMS ANY AND ALL LIABILITY THAT MAY ARISE FROM OR IN CONNECTION WITH SERVICES PROVIDED BY, DECISIONS MADE BY OR REPORTS OR CERTIFICATIONS ISSUED OR GRANTED BY ANY NFRC-ACCREDITED LABORATORY, NFRC-LICENSED IA OR ANY PRODUCT MANUFACTURER/ RESPONSIBLE PARTY; RELIANCE ON ANY NFRC PRODUCT DESCRIPTION, SPECIFICATION, RATING, TEST OR CERTIFICATION, WHETHER APPEARING IN A REPORT, A PRODUCT CERTIFICATION AUTHORIZATION OR A PRINTED OR ELECTRONIC DIRECTORY, OR ON A LABEL, OR ON A LABEL CERTIFICATE; OR THE SALE OR USE OF ANY NFRC-RATED OR CERTIFIED PRODUCT OR PRODUCT LINE; INCLUDING BUT NOT LIMITED TO DAMAGES FOR PERSONAL OR OTHER INJURY, LOST PROFITS, LOST SAVINGS OR OTHER CONSEQUENTIAL OR INCIDENTAL DAMAGES.

NFRC program participants are required to indemnify NFRC from and against such liability.



Table of Contents

Foreword	ii
Disclaimer	vi
1. Mandatory reporting requirements for Solar Calorimeter Testing laboratories	1
1.1 SOLAR CALORIMETER TESTING LABORATORY REPORTING REQUIREMENTS FOR NFRC 201	1
1.1.1 Solar Calorimeter Testing Laboratory Reporting Requirements	1
Appendix A	7
GUIDELINES TO DETERMINE IF THE TEST SPECIMEN IS PROPERLY REPRESENTED BY THE MANUFACTURER'S PRODUCT DRAWINGS	7

1. MANDATORY REPORTING REQUIREMENTS FOR SOLAR CALORIMETER TESTING LABORATORIES

1.1 Solar Calorimeter Testing Laboratory Reporting Requirements for NFRC 201

1.1.1 Solar Calorimeter Testing Laboratory Reporting Requirements

Testing laboratory shall issue a test report to the fenestration product manufacturer for whom NFRC testing was conducted and, upon approval from the manufacturer, shall issue the same report to the manufacturer's IA. Prior to the issuance of a final report, the test laboratory shall disassemble the test specimen in such a manner after testing in order to verify the description of the product in the test report. Test laboratories shall use the guidelines in Appendix A to verify the manufacturer's product drawings. Attachment films are exempt from the guidelines of verification in Appendix A, but not other fenestration attachment products.

- A. The solar calorimeter test report and the representative electronic upload shall identify one distinct product line represented by one upload matrix with a unique report number.
- B. Upon approval from the manufacturer (via written letter or electronic documentation), the same report shall be issued to the manufacturer's IA. The approval shall be included in the test folder or report.
- C. Drawings
 - i. If the specimen testing was for NFRC Certification of Test-Only products (i.e. garden windows, TDDs), then the testing laboratory shall include with the report the following:
 - a) Extrusion/Parts drawings
 - b) Bill of Materials , which includes part name, part number, and vendor
 - c) Assembly view drawings
 - d) Drawings and Bill of Material shall be authenticated by the testing laboratory. The authentication shall be indicated by the

laboratory stamp bearing the unique testing report number on the bill of materials and drawings to indicate that they are representative of the materials and profiles of the product.

- ii. Component tests such as center-of-glazing of products such as glass blocks and domed skylights, then the following are necessary to show important details:
 - a) A drawing showing important details and dimensions
 - b) Photographs
 - c) Cross-sectional views
- D. Name, address and phone number of the laboratory
- E. Location (if different than the laboratory address) and identification of test equipment utilized
- F. Name and address of the client
- G. Serial number, report number or other appropriate means of identifying each individual product line report
- H. A statement that the tests were conducted in full compliance with NFRC requirements
- I. NFRC Procedures and the editions under which the report was submitted (i.e. NFRC 201-2010)
- J. Detailed written description of the specimen including (some items listed may not be applicable in certain cases):
 - i. Manufacturer and series or model number
 - ii. General description of product (i.e., operator type, framing type, glazing type, spacer type)
 - iii. Test Specimen size (reported in both SI and IP units). Any non-standard test specimen size shall be explained.
 - iv. Physically measured parameters (sizes and thickness measured to 1 mm (1/32 inches); i.e., overall window dimensions, operable and/or fixed sash dimensions, glazing daylight openings, and door component parts)

- v. Glazing material(s), including thickness, coatings, and/or internal films (emissivity, as reported by the sample manufacturer) and their location (surface)
- vi. Measured air space at the edge-of-glazing and design gas fill % concentration and type, as reported by the sample manufacturer
- vii. Spacer materials and construction
- viii. Grille materials, placement and pattern
- ix. Detailed description of the framing, sash, frame and sash corner/joint construction, glazing installation, weatherstripping (types and locations), drainage and finish
- x. All hardware, operator and other components
- xi. All descriptive items in the test report, which have not been measured or verified by the test lab, must be clearly indicated in the report.

Report the following information, where applicable, for the period in which the solar calorimeter is in steady-state conditions as defined by Section 7.4 of NFRC 201;

- K. Description of surround panel and installation of test specimen
- L. Date and the Local Time of the beginning and end of the test period
- M. Description of the location of the solar calorimeter(s); and the foreground in view of the test specimen
- N. Previous date of each calibration test specified in Section 5 of NFRC 201; including the wall heat flux calibration test, surround panel flanking loss calibration test, calibration transfer standard test, fluid flow rate instrumentation, pyranometer and fluid temperature difference instrumentation.
- O. If the sample is not tested normal to the sun the average Solar Heat Gain Coefficient, SHGC, over a constant incident or profile angle; and the average incident angle, θ_E or average profile angle, ψ_E , of the incident solar irradiation (i.e., SHGC of 0.56 at a profile angle of 30 degrees) shall be reported.

- P. Range of solar calorimeter tilt and azimuth for the duration of the test; if the solar calorimeter moves over the duration of the test, describe the tracking system and strategy.
- Q. Average and extremes of exterior wind velocity and direction; and average and range of exterior surface heat transfer coefficient, h_{h-sun} , during the test
- R. Diagrams documenting all surface temperature locations (i.e., absorber plate, etc.) and corresponding temperatures at each location at the time of greatest solar irradiation. If the test specimen surface temperatures are measured, include the average surface temperature of the test specimen on the weather side, t_2 and calorimeter side, t_1 .
- S. Diagrams documenting all air temperature locations (i.e., inside, t_h and outside, t_c , of solar calorimeter) and corresponding temperatures at each location at the time of greatest solar irradiation.
- T. The average interior air temperature, t_c and exterior air temperature, t_h , measured during the test.
- U. Inlet fluid temperature, outlet fluid temperature, flow rate of the fluid, f and heat extracted by the fluid heat extraction system, Q_{fluid} , measured at the time of greatest solar irradiation.
- V. The heat flow across solar calorimeter walls (Q_{walls}) the time of maximum solar irradiation.
- W. The average standardized thermal transmittance, U_s ; a description of the method used to determine the average standardized thermal transmittance; including the heat flow due to thermal transmittance effects, $Q_{U-Factor}$, at the time of maximum solar irradiation.
- X. The temperature of the interior surface, t_{sp1} and the exterior surface of the surround panel, t_{sp2} , measured at the time of maximum solar irradiation; including the heat flow through the surround panel, Q_{sp} .
- Y. The heat added to the interior of the solar calorimeter by heaters, fans or pumps, Q_{AUX} , at the time of maximum solar irradiation.
- Z. The calculated heat flow through the test specimen, Q_s , measured that the time of maximum solar irradiation.

- AA. The maximum, minimum and average solar irradiation, E_s , measured over the duration of the test.
- BB. The procedures used to estimate the uncertainties shall also be documented as an Annex to the report, when available. (See Section 9.2 of NFRC 201 for Uncertainty Estimation)
- CC. The following statement shall be included in the test report directly after the above results are reported.

“This test method does not include separate procedures to determine the heat flows due to either air movement or nighttime U-factor effects. As a consequence, the SHGC results obtained do not reflect the overall performance which may be found in field installations due to temperature differences, wind, shading, air leakage effects and the thermal bridge effects specific to the design and construction of the fenestration system opening. Since there are a wide variety of fenestration system openings in residential, commercial and industrial buildings, it is not feasible to select a “typical” surround panel construction in which to mount the fenestration test specimen. The selection of a relatively high thermal resistance surround panel places the focus of the test on the thermal performance of the fenestration system alone. Therefore, it should be recognized that the thermal transmittance results obtained from this test method, for ideal laboratory conditions in a highly insulating surround panel, should only be used for fenestration product comparisons or as input to thermal performance analyses which also include thermal, air leakage and thermal bridge effects due to the surrounding building structure. To determine air leakage effects for windows and doors, refer to ASTM E 283. For thermal transmittance refer to ASTM C 1199.”

- DD. For Dynamic Glazing Products, reported data shall include ratings achieved at both the full ON and OFF or the full OPEN and CLOSED positions.
- EE. Any additional comments or data deemed important in the understanding or review of the report
- FF. Name and signature of individual conducting the test
- GG. Name and signature of individual accepting responsibility for the technical accuracy of a test report
- HH. A statement that the report relates only to the fenestration products tested

- II. If this product was a Test-Only option, then a statement indicating this shall be included in the report and a whether the product was submitted for initial certification or re-certification. A copy of the Submittal Form for Test Samples shall be submitted with the test report. Refer to Appendix D of NFRC 700 for submittal form.
- JJ. Rounding of numerical values shall be per NFRC 601, *NFRC Unit and Measurement Policy*.
- KK. The following statement shall be included in the report:
“Ratings included in this report are for submittal to an NFRC-licensed IA for certification purposes and are not meant to be used for labeling purposes. Only those values identified on a valid Certification Authorization Report (CAR) are to be used for labeling purposes.”
- LL. NFRC laboratories shall, as part of the report for Test-Only option products, upload the *NFRC Physical Testing CPD 2.0 Upload Sheet* to the NFRC database. The values in the *NFRC Physical Testing CPD 2.0 Upload Sheet* shall be consistent with any values in the NFRC report. The *NFRC Physical Testing CPD 2.0 Upload Sheet* must be in MS Excel® format and values must not be linked to other workbooks.
- MM. The test lab may choose to provide an electronic copy of the report as long as the report, in its entirety, is submitted in electronic format, stored on a remote secure server accessible by the designated IA or mailed on electronic media.

[**Note:** Electronic reports shall be protected by password or other means to prevent unauthorized modification. Laboratories shall maintain a secured back-up copy.]

APPENDIX A

GUIDELINES TO DETERMINE IF THE TEST SPECIMEN IS PROPERLY REPRESENTED BY THE MANUFACTURER'S PRODUCT DRAWINGS

1. The testing laboratory shall verify the test specimen to the drawings supplied by the manufacturer. This will be accomplished by comparing the physical samples of the product tested to the manufacturer's product drawings. The package of extrusion drawings, bill of materials, and fabrication drawings shall be authenticated by the testing laboratory's stamp referencing this data to the test report number or other test report identification. The testing laboratory's stamp or other mark on each individual drawing indicates that this drawing is representative of the material used in the tested sample. It also indicates, on the bill of materials and other data, in so far as it is possible to check, that the material used in the tested sample is that which was stated by the manufacturer.
2. The product samples should be verified in the following manner:
 - a. The base profile of the product sample extrusion must match the extrusion drawing. (i.e. internal air cavities, structural components, reinforcement, internal legs, etc. are the same)
 - b. The overall dimensions (width and height) of the sample profile should be checked to the physical dimensions stated on the profile drawings. In addition, other dimensions deemed critical should also be checked. Dimensional tolerances stated on the drawings should be used to indicate compliance.
 - c. Where possible, the bill of materials will be checked against the product tested to be certain that the type of material indicated on the drawings is the same type of material being used on the test specimen.
 - d. Any thermal break should be checked and verified for the effective distance (debridged width or effective width) between the inboard and outboard sides of the component containing the thermal break.
 - e. Where possible, check and indicate if the hardware described on the drawings and the bill of materials is the same type and is located in the same location as indicated on the assembly drawing.
3. The testing laboratory, by placing the stamp on a drawing, indicates that the drawing is representative of the test specimen.
4. If the test product drawing(s) do not verify that the product tested is the same as indicated on the drawings, the test laboratory shall illustrate on the drawing(s) the apparent differences in the test report.